

Shanghai Liangxin Electrical Co., Ltd.

NDM2E-100 Product Specification

(IPD-ENG-DEV-T20 A1 2016-09-23)

Prepared by	孙兰萍	Date	2021-09-28
Reviewed by	肖柏桃	Date	2021-09-29
Countersigned by	梅阳	Date	2021-09-30
Approved by	丁飞	Date	2021-09-30

Revision History					
Version	Revision Reason/Content	Implementati on Date	Prepared by	Reviewe d by	Approve d by
0	Newly added	5/8/2020	Wang Hu	Peng Haorang	Hu Qi
1	Update the product appearance picture and product dimension outline drawing	30/9/2021	Sun Lanping	Xiao Botao	Ding Fei

1. Applicable Scope and Purpose of Circuit Breaker

The NDM2E-100 series of electronic molded case circuit breakers (hereinafter referred to as circuit breakers) apply to infrequent switching of circuits with the AC50Hz, the working voltage of AC400V and working current of 100A as well as infrequent motor starting. With the overload, short circuit and undervoltage protection functions, the circuit breaker can protect lines and power equipment from damage. The NDM2E circuit breaker can provide modules with the communication function, which can make the original circuit breaker upgrade to the communication circuit breaker conveniently, thus realizing "Four remotes" functions, namely, remote control, remote adjustment, remote measuring and remote measurement.

2. Product Picture of Circuit Breaker (The picture is for reference only; the specific kind prevail)



Picture of the Product

3. Specification and Model Description of Circuit Breaker

ND	M	2	E	-	100	□	□	/	□	/	□	□	□	□	□
1	2	3	4	5	6	7	8	9	10	11	12	13	14		
SN	SN name					NDM2E									
1	Enterprise code					ND: "Nader" low-voltage apparatus									
2	Product code					M: Molded case circuit breaker (MCCB)									
3	Design SN					2									
4	Derived code of the series					E: Electronic									
5	Shell frame level					100									
6	Breaking capacity level					M: Relatively high breaking type									
						H: High breaking type									
7	Operation mode					No code: Direct handle-operated mode									
						P: Motor-operated									
						Z: Rotary operation									
8	Derived code of the function					No code: Basic type intelligent release									
						G: Ground protection type intelligent release									
						T: Communication type intelligent release									
						GT: Ground protection communication type intelligent release									
9	Number of poles					3									
10	Accessory code					See Table 1									
11	Application code					No code: Power distribution type									
						2: Motor protection type									
12	Setting current					See Table 2									
13	Cabling type					No code: Normal product									
						P: Connection busbar									
						Z1: Rear-plate connection									
						Z2H: Plug-in rear-plate connection									
						Z2Q: Plug-in front-plate connection									
14	Other codes					DT: Dedicated for power grid									
						Codes of internal and external accessories: Such as manual operation: CS1-A, electric operation: DC1 220V, shunt: AC230V, undervoltage: DC220V									

Table 1: Comparison Table of Accessory Code:

Legend

- Single auxiliary contact
- Dual-auxiliary contact
- Alarm contact
- Shunt release
- Under-voltage release
- Auxiliary alarm contact (a single accessory features the auxiliary and alarm functions)

Accessory code	Accessory name	NDM2E-100 (Non-communication type)		Accessory code	Accessory name	NDM2E-100 (Communication type)	
		Installation Position	Model			Installation Position	Model
		Number of poles				Number of poles	
		3				3	
300	N/A	—		300	None/communication type	—	
310	Shunt release			310	Shunt release/communication type		
320	Dual-auxiliary contact			320	Dual-auxiliary contact/communication type		
321	Single auxiliary contact			321	Single auxiliary contact/communication type		
330	Under-voltage release			330	Undervoltage release/communication type		
340	Shunt release, dual-auxiliary contact	—		341	Shunt release single auxiliary/communication type		
341	Shunt release, single auxiliary contact			308	Alarm contact/communication type		
350	Shunt release, under-voltage release	—		318	Shunt release, alarm contact/communication type		
360	Two sets of dual-auxiliary contacts	—		328	Dual-auxiliary contact, alarm contact/communication type		
361	Two sets of single auxiliary contacts			338	Under-voltage release, alarm contact/communication type		
362	Dual-auxiliary contact, single auxiliary contact	—		358	Auxiliary alarm contact/communication type		
370	Under-voltage release, dual-auxiliary contact			361	Single auxiliary contact, single auxiliary contact/communication type		
371	Under-voltage release, single auxiliary contact			371	Under-voltage release, single auxiliary contact/communication type		
308	Alarm contact						
318	Shunt release, alarm contact						
328	Dual-auxiliary contact, alarm contact						
338	Under-voltage release, alarm contact						
348	Shunt release, auxiliary alarm contact						
358	Auxiliary alarm contact						
368	Dual-auxiliary contact, auxiliary alarm contact	—					
378	Under-voltage release, auxiliary alarm contact						

Note :

- 1) The first number "3" of the release accessory code represents the intelligent controller with the three-section protection while the last two numbers represent the inner accessory code;
- 2) Since the communication type requires to use a set of right-side auxiliary contacts, the single auxiliary or alarm contact output is only located on the right side of the above accessory mode.

4. Main Technical Parameters of Circuit Breaker

Table 2 Main Technical Parameters of Circuit Breaker

Model		NDM2E-100	
Rated current of frame I_{nm} (A)		100	
Setting current I_r (A)		40, 50, 63, 70, 80, 90, 100	
Rated insulation voltage U_i (AC V)		800	
Rated impulse withstand voltage U_{imp} (V)		8000	
Rated working voltage U_e (AC V)		400	
Power frequency withstand voltage U (1min) (V)		3500	
Utilization category		A	
Rated short-time withstand current I_{cw} (kA/1s)		1	
Number of poles		3	
Breaking capacity level		M	H
Rated limit short-circuit breaking capacity I_{cu} (kA)	AC400V	50	85
Rated operating short-circuit breaking capacity I_{cs} (kA)	AC400V	50	50
Operating performance (times)	Electrical life		8000
	Mechanical life	Maintainable free life	20000
		Maintainable life	40000

4.1 Selection of the circuit breaker connecting bus or cable cross-section area

Table 3 Selection of the NDM2E-100 Connecting Bus or Cable Cross-section Area

Rated current (A)	40, 50	63	70, 80	90, 100
Wire cross-section area (mm ²)	10	16	25	35

4.2 Tightening Torque of the Circuit Breaker Terminal and Mounting Screw

Table 4 Tightening Torque of the Circuit Breaker Terminal and Mounting Screw

Model	Thread diameter (mm)	Torque (N·m)
NDM2E-100	M8	12
	M4	2.4

4.3 Derating factor of temperature change for the circuit breaker

Table 5 Derating Factor Table of Temperature Change for the Circuit Breaker

Model	Derating factor of product temperature change							
	Temperature (°C)	40	45	50	55	60	65	70
NDM2E-100	Derating factor	1	1	1	0.973	0.945	0.918	0.891

Note: 1) When the operating ambient temperature is below + 50°C, the product can be used normally without derating capacity.

2) The above derating factors are measured at the frame current.

4.4 High-altitude derating factor of the circuit breaker

Table 6 High-altitude Derating Factor Table of Circuit Breaker


Elevation (m)	Working current correction coefficient	Power frequency withstand voltage correction coefficient	Isolation voltage correction coefficient
2000	1	3500	800
2500	1	3500	800
3000	0.98	3150	720
3500	0.97	3000	680
4000	0.95	2800	630
4500	0.94	2650	600
5000	0.93	2500	560

5. Normal Working Environment of Circuit Breaker

- 1) The altitude of the installation site doesn't exceed 2,500m. See the "High-altitude Derating Factor Table of Circuit Breaker" for the derating factor at the altitude;
- 2) The ambient temperature is $-35^{\circ}\text{C} \sim +70^{\circ}\text{C}$; the average within 24 h shall not be more than $+35^{\circ}\text{C}$. If the ambient temperature is higher than $+50^{\circ}\text{C}$, the user needs to reduce the capacity. See the "Derating Factor Table of Temperature Change for the Circuit Breaker" for the derating factor;
- 3) Its relative humidity at an ambient temperature of $+40^{\circ}\text{C}$ should not exceed 50%. A higher relative humidity is allowed at a lower temperature. For example, the relative humidity at 20°C can reach 90%; for frost due to temperature change, the corresponding measures should be taken;
- 4) The product can withstand the effects of wet air, salt mist, oil mist and mould;
- 5) The installation category of the circuit breaker connected to the main loop is: Category III (power distribution and control level), The installation category of the circuit breaker not connected to the main loop is: Category II (load level);
- 6) The pollution level is Level 3;
- 7) The product should be installed in places that are free from explosive media, media corrosive to metal, insulation damaging gas, and conductive dust, which should be also avoided from snow and rain;
- 8) In case of stricter user conditions than the above description, negotiate with the manufacturer.


6. Short-circuit Overload Protection Characteristic Curve of Circuit Breaker

6.1. Time/current characteristic curve of power distribution protection type

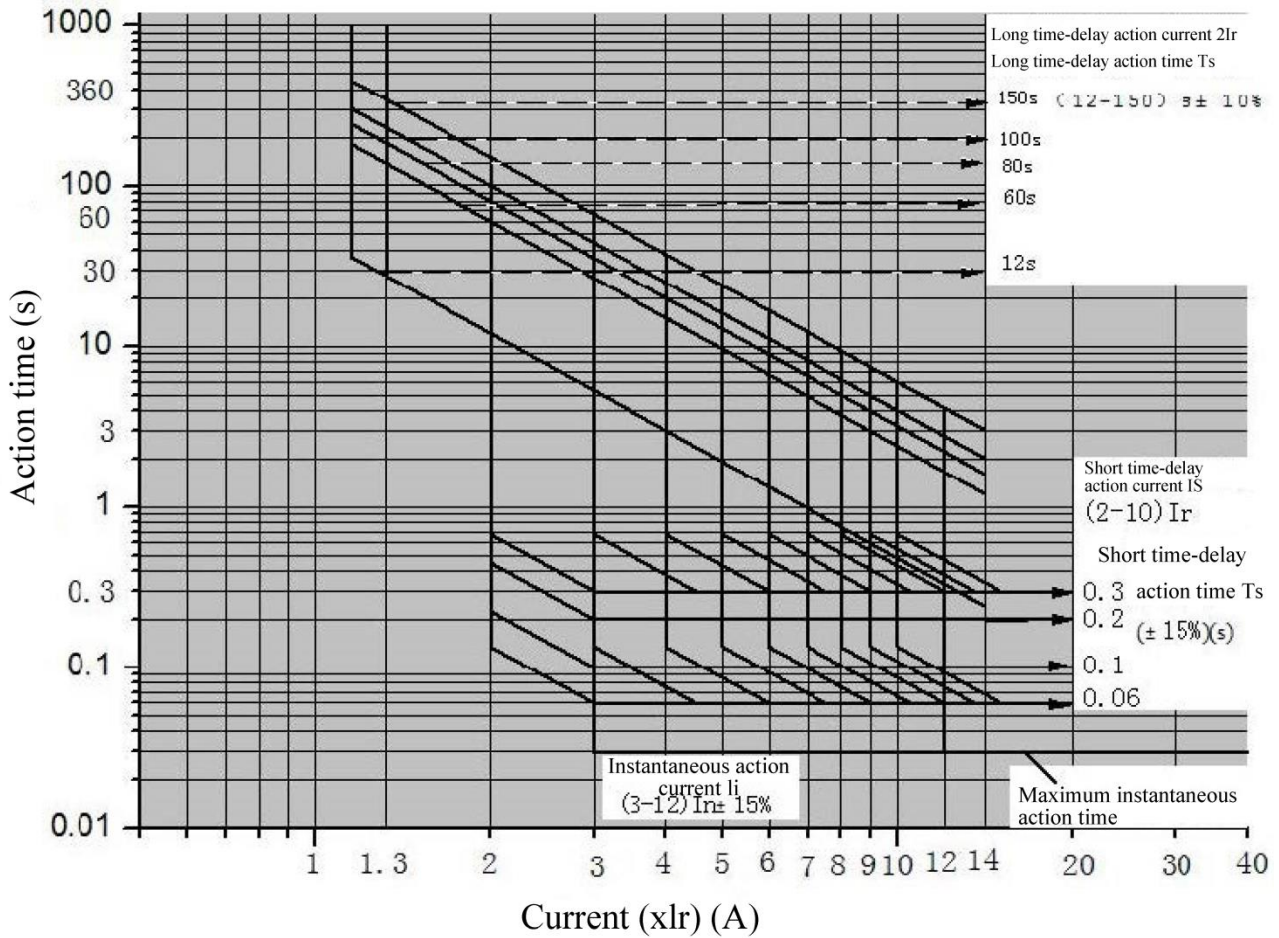


Time/Current Characteristic Curve

6.2. Time/current characteristic curve of ground protection type

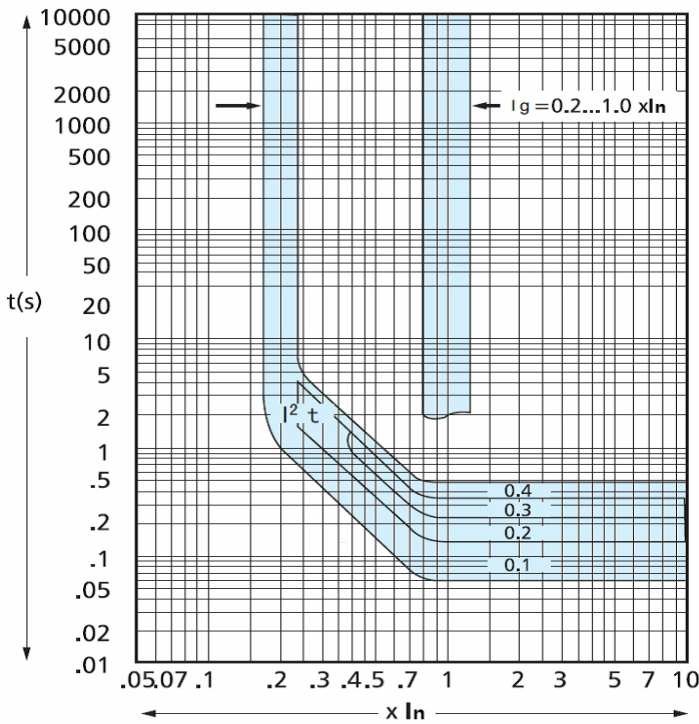

Time/Current Characteristic Curve

6.3. Time/current characteristic curve of motor protection type

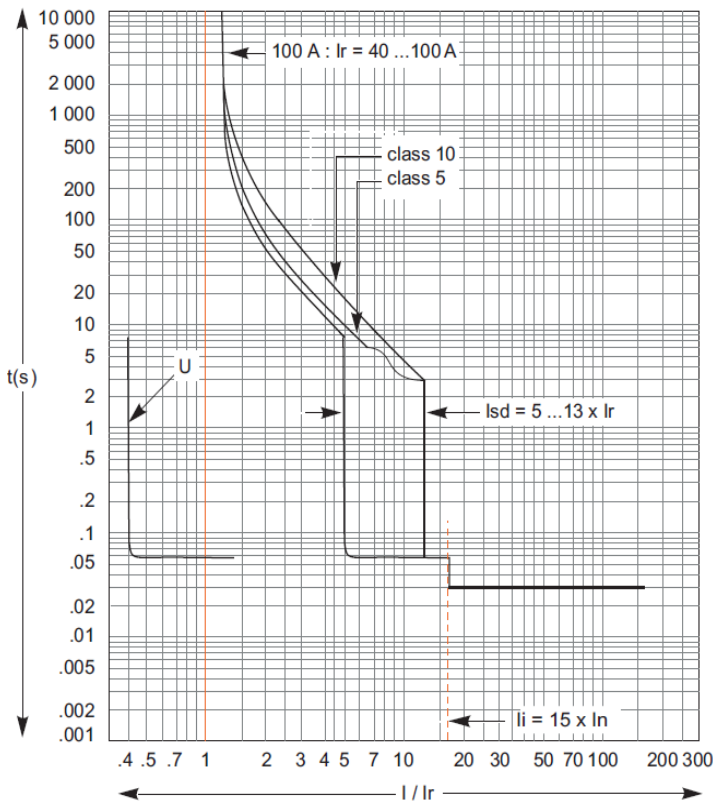

Time/Current Characteristic Curve

6.4. Setting value of the intelligent controller

6.4.1. Communication-type intelligent controller

Table 7 Communication-type Intelligent Controller

Model	Rated current of frame In(A)	Current and time parameters							
		Ir(A)	Tr(s)	Isd (*Ir)	Tsd(s)	Ii (*In)	Ip (*Ir)	Ig (*In)	Tg(s)
NDM2E-100	100	40, 50	12	2,3, 4	0.06	3, 4, 5	0.7	0.2, 0.3	0.1
		63, 70	60	5, 6, 7	0.1	6,3, 7	0.8	0.4, 0.5	0.2
		80, 90	80	8, 10	0.2	8, 9	0.9	0.6, 0.8	0.3
		100, OFF	100	OFF	0.3	10, 12	1.0	1.0, OFF	0.4

Note: When Isd is in the OFF position, the short time-delay is closed.

6.4.2. Non-communication type intelligent controller

Table 8 Communication-type Intelligent Controller

Model	Rated current of frame In(A)	Current and time parameters							
		Ir(A)	Tr(s)	Isd (*Ir)	Tsd(s)	Ii (*In)	Ip (*Ir)	Ig (*In)	Tg(S)
NDM2E-100	100	40, 50	12	2,3, 4	0.06	3, 4, 5	0.7	0.2, 0.3	0.1
		63, 70	60	5, 6, 7	0.1	6,3, 7	0.8	0.4, 0.5	0.2
		80, 90	80	8, 10	0.2	8, 9	0.9	0.6, 0.8	0.3
		100, OFF	100	OFF	0.3	10, 12	1.0	1.0, OFF	0.4

Note: When Ir is in the OFF position, the long and short time-delay is closed at the same time; when Isd is in the OFF position, the short time-delay is closed.

6.4.3. Motor protection-type intelligent controller

Table 9 Motor Protection-type Intelligent Controller

Model	Shell frame level Rated current In(A)	Current and time parameters			
		Ir(*In)	Class(s)	Isd(*Ir)	Iunbl (%)
NDM2E-100	100	0.4, 0.5, 0.6, 0.7, 0.8, 0.9, 1.0	4-10	5, 6, 7, 8, 9 10, 11, 12, 13 OFF	10, 20, 30 40, OFF

Note: 1) When Isd is in the OFF position, the short time-delay is closed;

2) When Iunbl is in the OFF position, the current imbalance protection is off;

3) The short circuit instantaneous Ii has built-in 15In.

6.5. Protection characteristics of power distribution-type circuit breaker

Table 10 Protection Characteristics of Intelligent Release

Overload long time-delay protection I_r , T_r							
Setting current I_r			See Table 7 or 8				
Action features (reverse time limit)	Tr setting value (s)	In = 100A					
		12	60	80	100		
	$\leq 1.05I_r$	>2h inaction					
	$> 1.30I_r$	<1h action					
	t(s) at 1.5 I_r	21.3	106.7	142.2	177.8		
	t(s) at 2.0 I_r	12	60	80	100		
	t(s) at 7.2 I_r	0.93	4.63	6.17	7.72		
	Accuracy (%)	± 10					
Note: The action curve conforms to $t=(2I_r/I)^2 \times T_r$ t: overload long time-delay action time T_r : setting value of the overload long time-delay action time I: Actual running current I_r : setting value of the overload long time-delay action current							
Short circuit short-time delay protection I_{sd} , T_{sd}							
Setting current I_{sd}			See Table 7 or 8				
Action characteristics	Reverse time limit $I_{sd} \leq I < 1.5I_{sd}$	Tsd setting value (s)	0.06	0.1	0.2	0.3	
		t action time (s)	$t=(1.5I_{sd}/I)^2 \times T_{sd}$				
	Fixed time limit $1.5I_{sd} \leq I < I_i$	t action time (s)	0.06	0.1	0.2	0.3	
		Returnable time (s)	/	/	0.14	0.21	
		Accuracy (%)	± 10				
Note: The inverse time limit action curve conforms to $t=(1.5I_{sd}/I)^2 \times T_{sd}$ The reverse time limit is ON while the fixed time limit is OFF t: short-circuit short time-delay action time T_{sd} : setting value of the short-circuit short time-delay action time I: Actual running current I_{sd} : setting value of the short-circuit short time-delay action current							

Table 10 (Continued) Protection Characteristics of Intelligent Release


Short circuit instantaneous protection I_i						
Action characteristics	Setting current I_i		See Table 7 or 8			
	Action time		<50ms			
Pre-alarm I_p						
Setting current I_p			See Table 7 or 8			
characteristics	Alarm indicator		The indicator changes to be constantly on from flashing			
	Accuracy (%)		±10			
Overload indicator (maximum load)						
characteristics	Current value range		1.15× I_r			
	Overload indicator		Constantly on			
	Accuracy (%)		±10			
Ground fault protection I_g, T_g						
Setting current I_g			(0.2, 0.3, 0.4, 0.5, 0.6, 0.8, 1.0)× I_n +OFF			
Action characteristics	Reverse time limit $I_g \leq I_{\Delta} < 2I_g$	T _g setting value (s)	0.1	0.2	0.3	0.4
		t action time (s)	$t = (2I_g/I)^2 \times T_g$			
	Fixed time limit $I_{\Delta} \geq 2I_g$	t action time (s)	0.1	0.2	0.3	0.4
		Accuracy (%)	±10			
Note: I: 3P products are A/B/C three-phase current vector sum.						

6.6. Protection characteristics of the motor protection-type intelligent release

Table 11 Protection characteristics of the motor protection-type intelligent release

Overload protection Ir, Class								
Setting current Ir		See Table 7 or 8						
Action features (reverse time limit)	Class setting value (s)	4	5	6	7	8	9	10
	$\leq 1.05 I_r$	$> 2h$ inaction						
	$> 1.20 I_r$	$< 1h$ action						
	tr(s) at 1.5 Ir	92.2	115.2	138.2	161.3	184.3	207.4	230.4
	tr(s) at 6.0 Ir	5.8	7.2	8.6	10.1	11.5	12.9	14.4
	tr(s) at 7.2 Ir	4	5	6	7	8	9	10
	Accuracy (%)	± 10						
Note: The action curve conforms to $t=(7.2)^{2 \times (I_r)} \times \text{Class} / I^2$ t: Overload protection action time Class: Setting value of the tripping level time I: Actual running current Ir: Setting value of the overload protection action current								
Short circuit short-time delay protection Isd								
Setting current Isd		See Table 7 or 8						
Action characteristics	Fixed time limit	t action time (s)					0.06	
	$I_{sd} < I$	Accuracy (%)					± 10	
Current unbalance protection Iunbl								
Setting value Iunbl(%)		See Table 7 or 8						
Action characteristics	$\delta \geq I_{unbl}(\%)$	During startup ($< \text{Class}$)		t action time (s)		0.7		
		During normal operation ($\geq \text{Class}$)				4		
	$\delta < I_{unbl}(\%)$	Inaction						
Note: The calculation of the actual current unbalance conforms to $\delta=(I_{max}-I_{min}) \times 3 \times 100\% / (I_a+I_b+I_c)$ δ : Percentage value of the actual current unbalance of the three-phase electricity I _{max} : Maximum current value I _{min} : Minimum current value I _a : A-phase current value I _b : B-phase current value I _c : C-phase current value								
Open-phase protection								
Action characteristics	$I < 0.4 I_r$	During startup ($< \text{Class}$)		t action time (s)		0.7		
		During normal operation ($\geq \text{Class}$)				4		
Short circuit instantaneous protection Ii								
Setting current Ii	See Table 7 or 8							
Action time	$< 50 \text{ ms}$							

6.7. Communication module characteristics

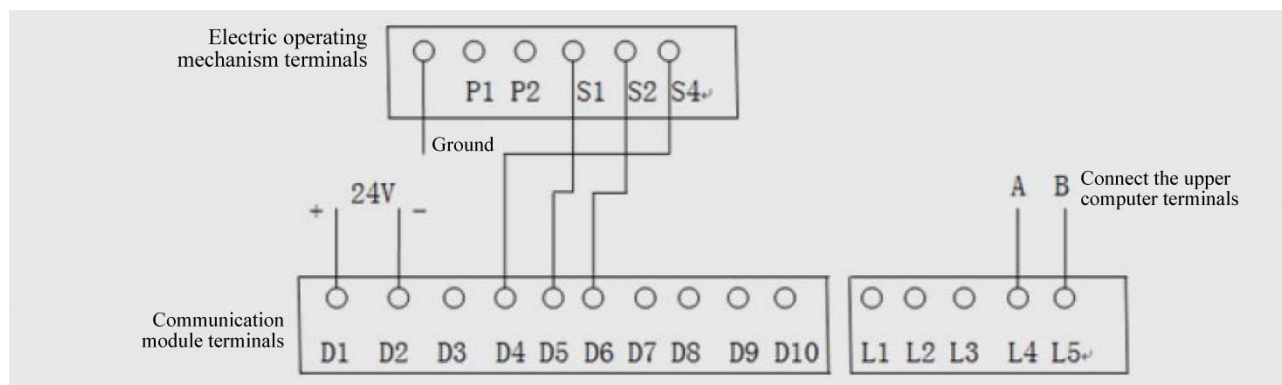

Connection diagram of communication module and electric operating mechanism

Terminal code	Connection position	Input/output (IO)
D1	Power input DC24V(+)	Input
D2	Power input DC24V(-)	
D3	Empty	Output (DO)
D4	“OFF” control terminal of the electric operating mechanism	
D5	“COM” control terminal of the electric operating mechanism	
D6	“ON” control terminal of the electric operating mechanism	
D7	Empty	Input (DI)
D8, D9	Network control options	
D10	Empty	Output
L1	Power DC5V(+)	
L2	Power DC5V(-)	
L3	PE	Input/output
L4	Receive/send data (A)	
L5	Receive/send data (B)	


Note: 1) Specification of the rated working voltage: DC 24V, allowed range: $\pm 15\%$, power $\leq 2W$.

2) DI, switch input, input impedance: $\leq 100\Omega$


3) DO, switch output, contact capacity: Resistive load DC30V/5A, AC270V/3A.

7. Outline and Mounting Hole Dimensions of Circuit Breaker

7.1 Outline and mounting hole dimensions of circuit breaker

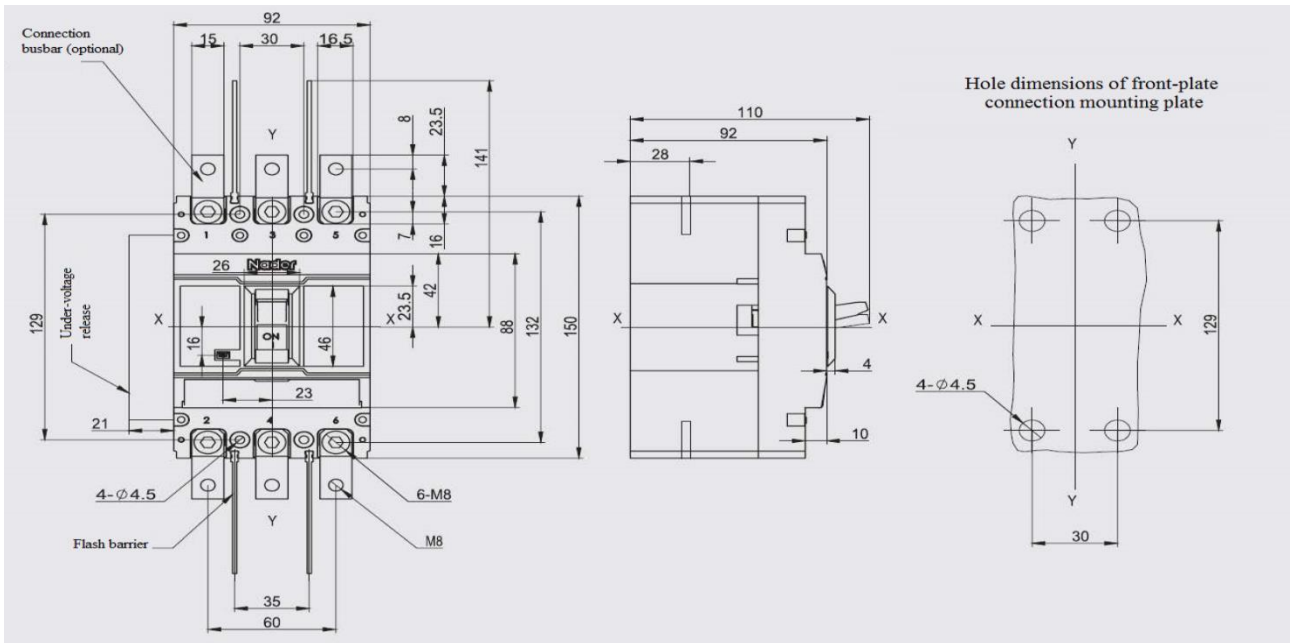

7.2 Installation dimensions of communication module

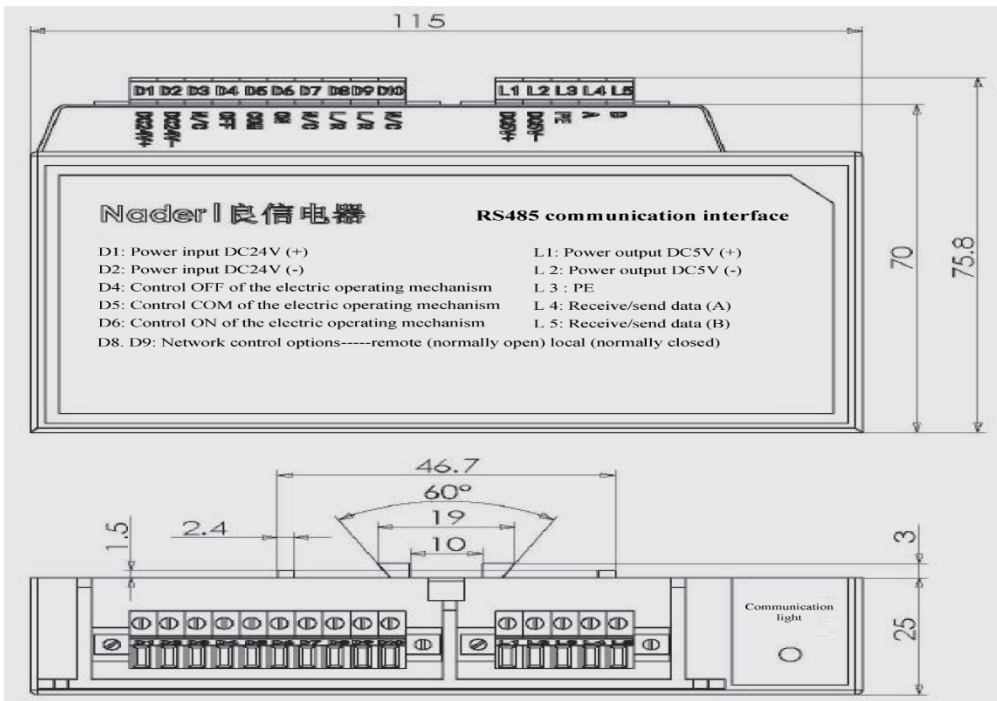

Note: The limit deviation not indicated with the tolerance dimensions is as per GB/T 1804-c.

7.3 Safe mounting distance of circuit breaker

Table 7 Insulation Distance Mounted in the Metal Cabinet (Unit: mm)

Mounting distance	A (inlet wire end to the cabinet face)		B (distance from side to the cabinet face)	C (outlet wire end to the cabinet face)
	With a terminal cover	Without a terminal cover		
Model				
NDM2E-100	25	65	30	30

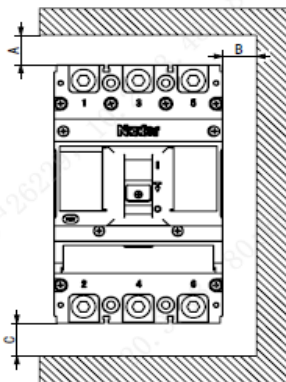


Table 8 Minimum Center Distance between Rowed Circuit Breakers (Unit: mm)

Model	Width of circuit breaker	I Center distance
	3 poles	3 poles
NDM2E-100	92	122

Note: Check the connected busbar or cable during rowing or stacking of the circuit breaker to ensure that the air insulation distance won't be reduced.

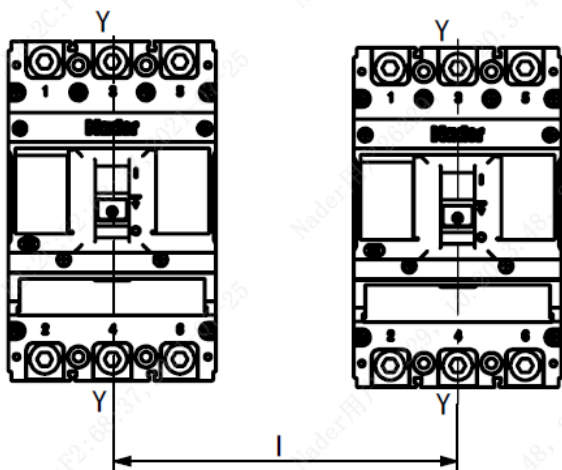


Table 9 Minimum Distance between Stacked Circuit Breakers (Unit: mm)


Model	H (distance of circuit breaker from bottom)	
	With a terminal cover	Without a terminal cover
NDM2E-100	90	91

Note: 1) Bare cable connection

2) Cable insulating connection

3) Connection without insulation


Requirements: Check whether the terminal cover or phase partition is assembled properly before products are energized.

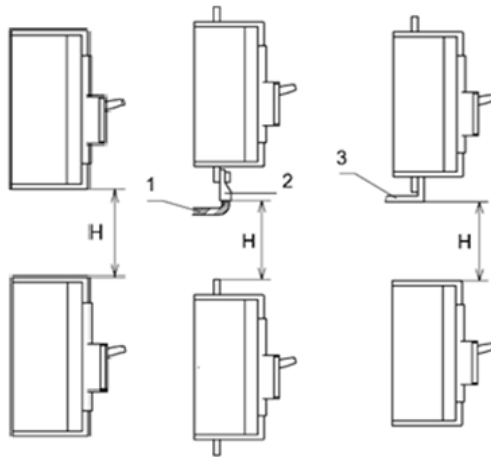

8. Installation Direction of Circuit Breaker

For vertical installation of the product, the gradient between the installation surface and the vertical plane is no more than $\pm 22.5^\circ$.

Horizontal installation of the product.

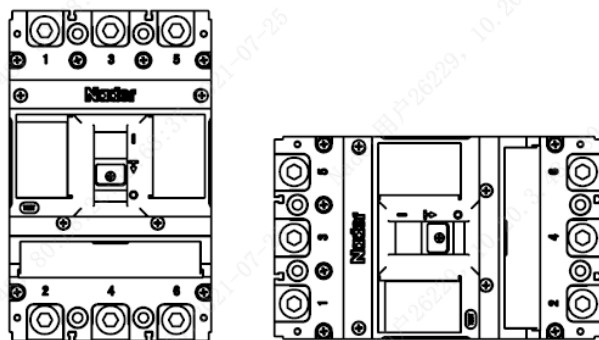

Vertical Installation

Horizontal Installation

9. Packaging and Storage of Circuit Breaker

Minimum packaging quantity: 1 piece/box. The packaged products should be stored in a warehouse with the air ventilation and the relative humidity no more than 80% when the ambient temperature is $-40^{\circ}\text{C}\sim+75^{\circ}\text{C}$. No acidic alkaline or other corrosive gas exists in the ambient air in the warehouse. Under the conditions above, the storage period shall be no more than three years since the manufacturing date.

10. Installation Direction of Circuit Breaker

SN	Name	Specification	3P Quantity/Set
1	Cross small pan-head screw	M4×45	4
2	Hexagon nut	M4	4
3	Spring washer	4	4
4	Plain washer	4	4
5	Phase partition	——	4

11. Circuit Breaker Notes

- 1) Various characteristics and accessories of the circuit breaker are set in the factory. The circuit breaker, tripping unit or other accessories can only be adjusted, installed and maintained by the trained or qualified professionals according to the parameter requirements of the line design;
- 2) Ensure that the power supply is off before installing or removing any device;
- 3) The circuit breaker handle can be located in three positions, indicating three states: on, off and free tripping. When the handle is in the free tripping position, pull the handle in the off direction when the circuit breaker is connected and on.