

Shanghai Liangxin Electrical Co., Ltd.

NDM2L-250 Product Specification

(IPD-ENG-DEV-T20 A1 2016-09-23)

Prepared by	孙兰萍	Date	2021-09-28
Reviewed by	徐富平	Date	2021-09-28
Countersigned by	黄金华	Date	2021-09-28
Approved by	丁飞	Date	2021-09-28

Post code: 201315 Tel.: (021) 68586699
Page 2 of 13

1. Applicable Scope and Purpose of Circuit Breaker

The NDM2L-250 molded case circuit breaker with the residual current protection (hereinafter referred to as circuit breaker) applies to infrequent switching of circuits with the AC 50/60Hz, the working voltage of AC415V and the working current up to 250A. With the overload, short circuit and undervoltage protection functions, the circuit breaker can protect lines and power equipment from damage. Meanwhile, they can deal with the personal safety, fire hazards and other potential risks caused due to long-term ground faults that can't be detected with the overcurrent protection function.

2. Product Picture of Circuit Breaker (The picture is for reference only; the specific kind prevail)

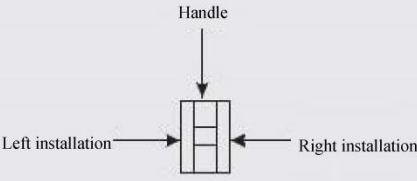






































Picture of the Product

3. Specification and Model Description of Circuit Breaker

$\frac{\text{ND}}{1}$	$\frac{\text{M}}{2}$	$\frac{2}{3}$	$\frac{\text{L}}{4} - \frac{\square}{5}$	$\frac{\square}{6}$	$\frac{\square}{7} / \frac{\square}{8}$	$\frac{\square}{9}$	$\frac{\square}{10} / \frac{\square}{11}$	$\frac{\square}{12}$	$\frac{\square}{13}$	$\frac{\square}{14}$	$\frac{\square}{15}$	$\frac{\square}{16}$	$\frac{\square}{17}$
SN	SN name				NDM2L								
1	Enterprise code				ND: “Nader” low-voltage apparatus								
2	Product code				M: Molded case circuit breaker (MCCB)								
3	Design SN				2								
4	Derived code of the series				L: Residual current protection								
5	Shell frame level				250								
6	Breaking capacity level				M: Relatively high breaking type								
					H: High breaking type								
7	Operation mode				No code: Direct handle-operated mode								
					P: Motor-operated								
					Z: Rotary operation								
8	Derived code of the function				No code: Type AC current leakage protection type								
					A: Type A current leakage protection type								
9	Delay type				X: Non-time delay								
					Y: Delay								
					XI: Non-time delay + alarm non-tripping								
					YI: Delay + alarm non-tripping								
10	Residual current release type				V: Type V residual current release								
11	Number of poles				3, 4								
12	Release code				3: Complex tripper								
13	Accessory code				See Table 1								
14	Application code				No code: Power distribution type								
15	N-pole (neutral pole) type of the 4P product				A: The N-pole isn't installed with an overcurrent release, but always connected								
					B: The N-pole isn't installed with an overcurrent release, but on-off with the other three poles								
					C: The N-pole is installed with an overcurrent tripper, and on-off with the other three poles								
16	Rated current				See Table 2								
17	Cabling type				No code: Normal product								
					P: Connection busbar								
					Z1: Rear-plate connection								
					Z2H: Plug-in rear-plate connection								
					Z2Q: Plug-in front-plate connection								
					Z3H: Integrated plug-in rear-plate connection								
					Z3Q: Integrated plug-in front-plate connection								
Note:													
1、 When the operation mode is electric operation or manual operation, the residual action current gear, residual current action time gear, and leakage indication button can't be adjusted;													
2、 Lower inlet wire not allowed for the 4P Type A product.													

Table 1: Comparison Table of Accessory Code:

			Legend  Single auxiliary contact  Dual-auxiliary contact  Alarm contact  Shunt release  Under-voltage release  Auxiliary alarm contact (a single accessory features the auxiliary and alarm functions)	
Accessory code	Accessory name	Model	NDM2L-250	
			3	4
00	N/A		—	
10	Shunt release			
20	Dual-auxiliary contact			
21	Single auxiliary contact			
30	Under-voltage release			
40	Shunt release, dual-auxiliary contact			
41	Shunt release, single auxiliary contact			
60	Two sets of dual-auxiliary contacts			
61	Two sets of single auxiliary contacts			
62	Dual-auxiliary contact, single auxiliary contact			
70	Under-voltage release, dual-auxiliary contact			
71	Under-voltage release, single auxiliary contact			
08	Alarm contact			
28	Dual-auxiliary contact, alarm contact			
58	Auxiliary alarm contact			
68	Dual-auxiliary contact, auxiliary alarm contact			

Note: The 3P product can only be available with the left-installed single accessory with the accessory code as 10, 20, 21, 30, 08, 58;

For two accessories provided with 4P, the alarm non-tripping function can't be selected simultaneously.

4. Main Technical Parameters of Circuit Breaker

Table 2 Main Technical Parameters of Circuit Breaker

Model			NDM2L-250			
Rated current of frame Inm (A)			250			
Rated current In (A)			100, 125, 140, 160, 180, 200, 225, 250			
Rated insulation voltage Ui (AC V)			1000			
Rated impulse withstand voltage Uimp (V)			8000			
Rated working voltage Ue (AC V)			380/400/415			
Utilization category			A			
Number of poles			3		4	
Breaking capacity level			M	H	/	
Rated limit short-circuit breaking capacity Icu (kA)			52.5	85	52.5	
Rated operating short-circuit breaking capacity Ics (kA)			35	50	35	
Rated residual short-circuit making and breaking capacity IΔm(kA)			0.25 Icu			
Rated residual action current IΔn(mA)		Non-time delay	Type AC	Type V 30/100/300/500		
			Type A	Type V 30/100/300/500		
		delay	Type AC	Type V 100/300/500		
			Type A	Type V 100/300/500		
Rated residual non-action current IΔno(mA)			0.5IΔn			
Residual current action time	Residual current		IΔn	2IΔn	5IΔn	10IΔn
	Non-time delay	Maximum breaking time (s)	0.2	0.1	0.04	0.04
	delay	Maximum breaking time (s)	0.5, 1.15 2.15	0.35, 1 2	0.25, 0.9 1.9	0.25, 0.9 1.9
		Limit non-driving time (s)	/	0.1, 0.5 1	/	/
Operating performance (times)		Electrical life		8000		
		Mechanical life	Maintainable free life	20000		
			Maintainable life	40000		

4.1 Selection of the circuit breaker connecting bus or cable cross-section area:

Table 3 Selection of the NDM2L-250 Connecting Bus or Cable Cross-section Area

Rated current (A)	100	125, 140	160	180, 200, 225	250
Wire cross-section area (mm ²)	35	50	70	95	120

4.2 Tightening Torque of the Circuit Breaker Terminal and Mounting Screw

Table 4 Tightening Torque of the Circuit Breaker Terminal and Mounting Screw

Model	Thread diameter (mm)	Torque (N·m)
NDM2L-250	M8	12
	M4	2.4

4.3 Derating factor of temperature change for the circuit breaker

Table 5 Derating Factor Table of Temperature Change for the Circuit Breaker

Model	Derating factor of product temperature change							
NDM2L-250	Temperature (°C)	40	45	50	55	60	65	70
	Derating factor	1	0.982	0.963	0.944	0.924	0.904	0.882

Note: 1) When the operating ambient temperature is below +40°C, the product can be used normally without derating capacity.

2) The above derating factors are measured at the frame current.

4.4 High-altitude derating factor of the circuit breaker


Table 6 High-altitude Derating Factor Table of Circuit Breaker

Elevation (m)	Working current correction coefficient	Power frequency withstand voltage correction coefficient (V)	Isolation voltage correction coefficient (V)
2000	1	3500	1000
2500	1	3500	1000
3000	0.98	3150	900
3500	0.97	3000	850
4000	0.95	2800	810
4500	0.94	2650	770
5000	0.93	2500	730

5. Normal Working Environment of Circuit Breaker

- 1) The altitude of the installation site doesn't exceed 2,500m. See the "High-altitude Derating Factor Table of Circuit Breaker" for the derating factor at the altitude;
- 2) The ambient temperature is $-35^{\circ}\text{C} \sim +70^{\circ}\text{C}$; the average within 24 h shall not be more than $+35^{\circ}\text{C}$. If the ambient temperature is higher than $+40^{\circ}\text{C}$, the user needs to reduce the capacity. See the "Derating Factor Table of Temperature Change for the Circuit Breaker" for the derating factor;
- 3) Its relative humidity at an ambient temperature of $+40^{\circ}\text{C}$ should not exceed 50%. A higher relative humidity is allowed at a lower temperature. For example, the relative humidity at 20°C can reach 90%; for frost due to temperature change, the corresponding measures should be taken;
- 4) The product can withstand the effects of wet air, salt mist, oil mist and mould;
- 5) The installation category of the circuit breaker connected to the main loop is: Category III (power distribution and control level), The installation category of the circuit breaker not connected to the main loop is: Category II (load level);
- 6) The pollution level is Level 3;
- 7) The product should be installed in places that are free from explosive media, media corrosive to metal, insulation damaging gas, and conductive dust, which should be also avoided from snow and rain;
- 8) In case of stricter user conditions than the above description, negotiate with the manufacturer.

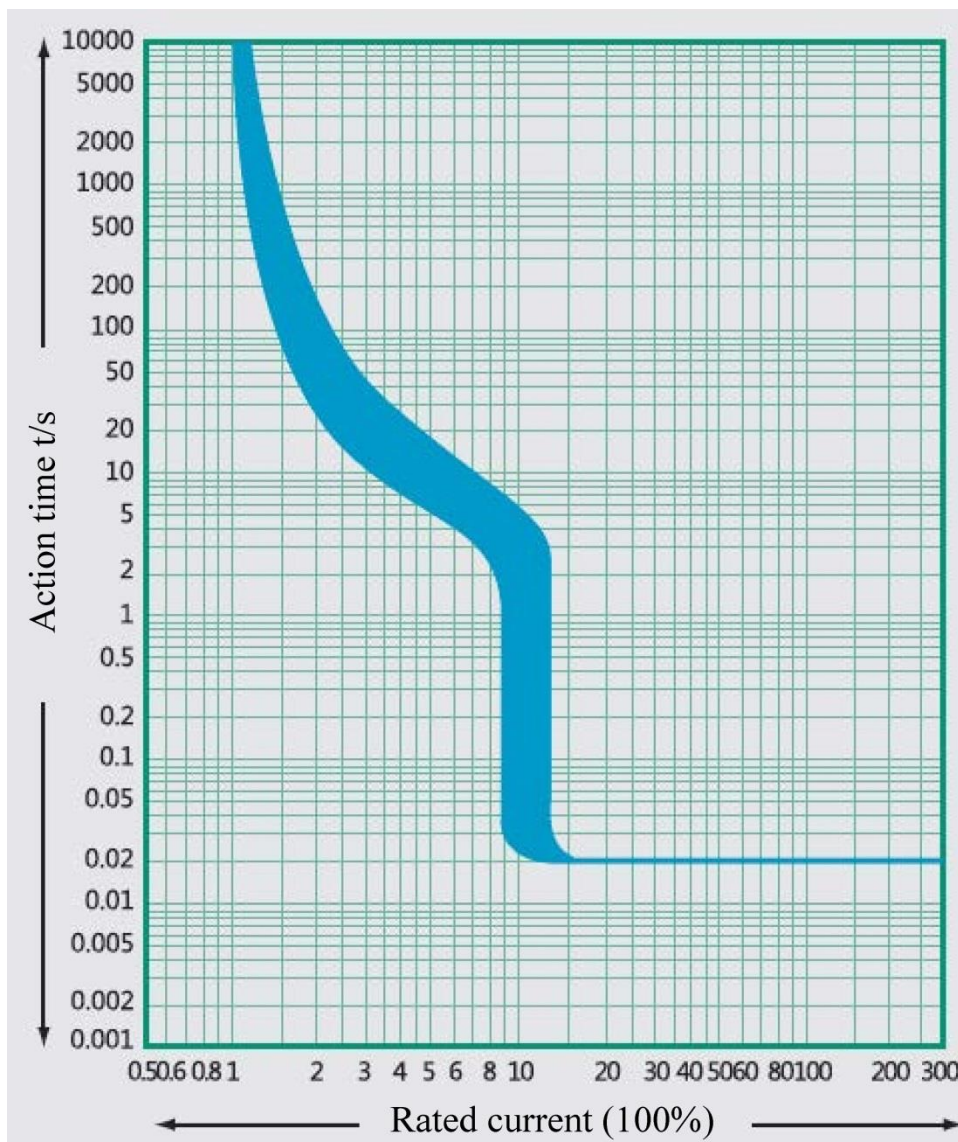
6. Short-circuit Overload Protection Characteristic Curve of Circuit Breaker



Time/Current Characteristic Curve

7. Outline and Mounting Hole Dimensions of Circuit Breaker

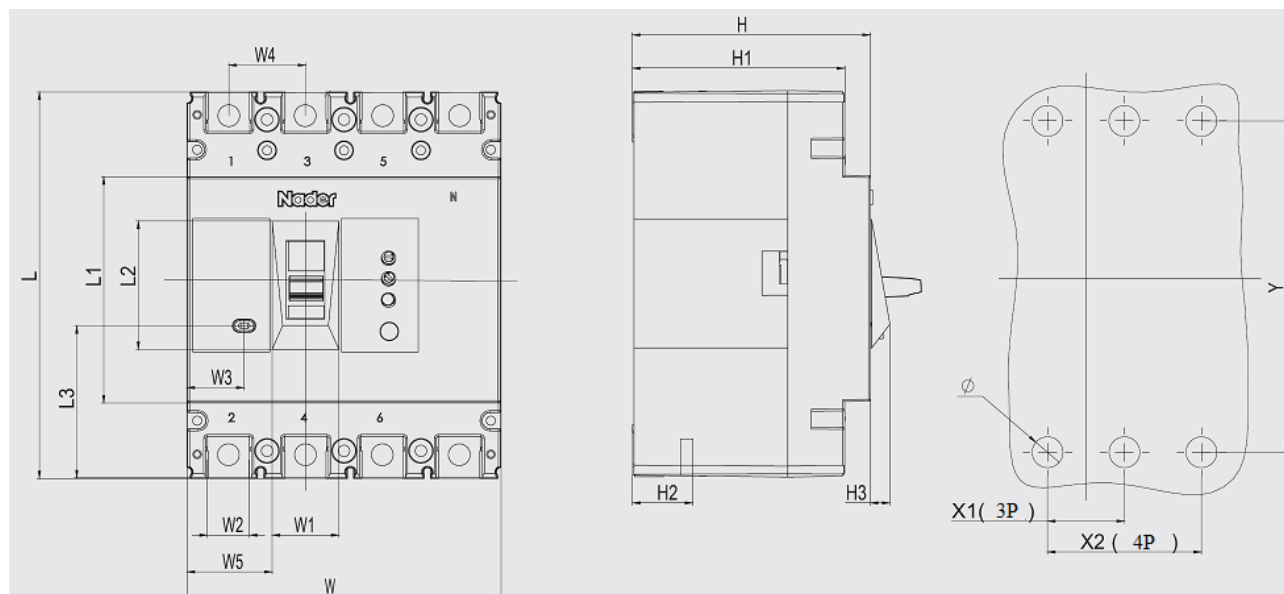7.1 Outline and mounting hole dimensions of circuit breaker



Product model	L	L1	L2	L3	W		W1	W2	W3	W4	W5	H	H1	H2	H3	Y	X1 (3P)	X2 (4P)	Φ
					3P	4P													
NDM2L-250	165	102	50	67	107	142	29	23	11	35	39	91	85.5	23.5	6.5	126	35	70	4.5

Note: The limit deviation not indicated with the tolerance dimensions is as per GB/T 1804-c.

7.2 Safe mounting distance of circuit breaker

Table 7 Insulation Distance Mounted in the Metal Cabinet (Unit: mm)

Mounting distance	A (inlet wire end to the cabinet face)		B (distance from side to the cabinet face)	C (outlet wire end to the cabinet face)
Model	With a terminal cover	Without a terminal cover		
NDM2L-250	25	65	30	30

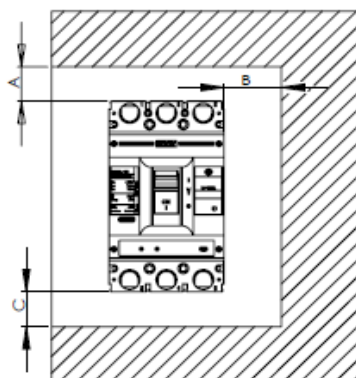


Table 8 Minimum Center Distance between Rowed Circuit Breakers (Unit: mm)

Model	Width of circuit breaker		I Center distance	
	3 poles	4 poles	3 poles	4 poles
NDM2L-250	107	142	137	172

Note: Check the connected busbar or cable during rowing or stacking of the circuit breaker to ensure that the air insulation distance won't be reduced.

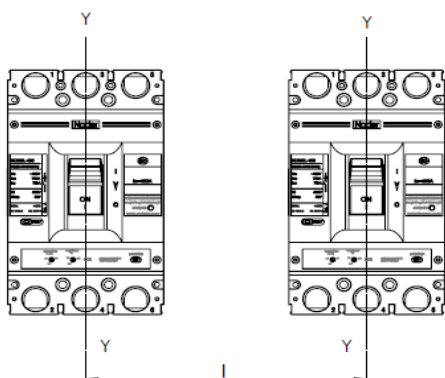


Table 9 Minimum Distance between Stacked Circuit Breakers (Unit: mm)


Model	H (distance of circuit breaker from bottom)	
	With a terminal cover	Without a terminal cover
NDM2L-250	90	93

Note: 1) Bare cable connection

2) Cable insulating connection

3) Connection without insulation

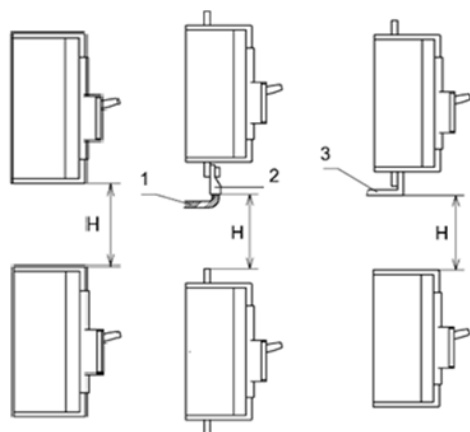
Requirements: Check whether the terminal cover or phase partition is assembled properly before products are energized.



8. Installation Direction of Circuit Breaker

For vertical installation of the product, the gradient between the installation surface and the vertical plane is no more than $\pm 22.5^\circ$.

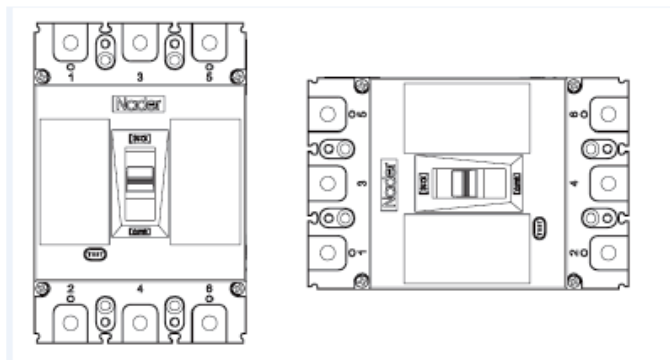Horizontal installation of the product.



Vertical Installation

Horizontal Installation

9. Packaging and Storage of Circuit Breaker

Minimum packaging quantity: 1 piece/box. The packaged products should be stored in a warehouse with the air ventilation and the relative humidity no more than 80% when the ambient temperature is $-40^\circ\text{C} \sim +75^\circ\text{C}$. No acidic alkaline or other corrosive gas exists in the ambient air in the warehouse. Under the conditions above, the storage period shall be no more than three years since the manufacturing date.

10. Installation Direction of Circuit Breaker

SN	Name	Specification	3P Quantity/Set	4P Quantity/Set
1	Cross small pan-head screw	M4×75	4	6
2	Hexagon nut	M4	4	6
3	Spring washer	4	4	6
4	Plain washer	4	4	6
5	Phase partition	——	4	6

11. Circuit Breaker Notes

- 1) Various characteristics and accessories of the circuit breaker are set in the factory. The circuit breaker, tripping unit or other accessories can only be adjusted, installed and maintained by the trained or qualified professionals according to the parameter requirements of the line design;
- 2) Ensure that the power supply is off before installing or removing any device;
- 3) The circuit breaker handle can be located in three positions, indicating three states: on, off and free tripping. When the handle is in the free tripping position, pull the handle in the off direction when the circuit breaker is connected and on.